


STACK DETAIL (DRAIN/WASTE/VENT) PRE-FABRICATED FLASHING

1. Plumbing Vent Stack (Drain/Waste/Vent) by others.
2. True Seal™ Caulking
3. Stainless Steel Pipe Clamp
4. True Seal™ Caulking
5. True Seal™ Pre-fabricated Pipe Flashing
6. True Seal™ Metal Membrane Plate
7. True Seal™ Membrane
8. Approved True Seal™ Insulation and/or cover Board
9. Roof Deck

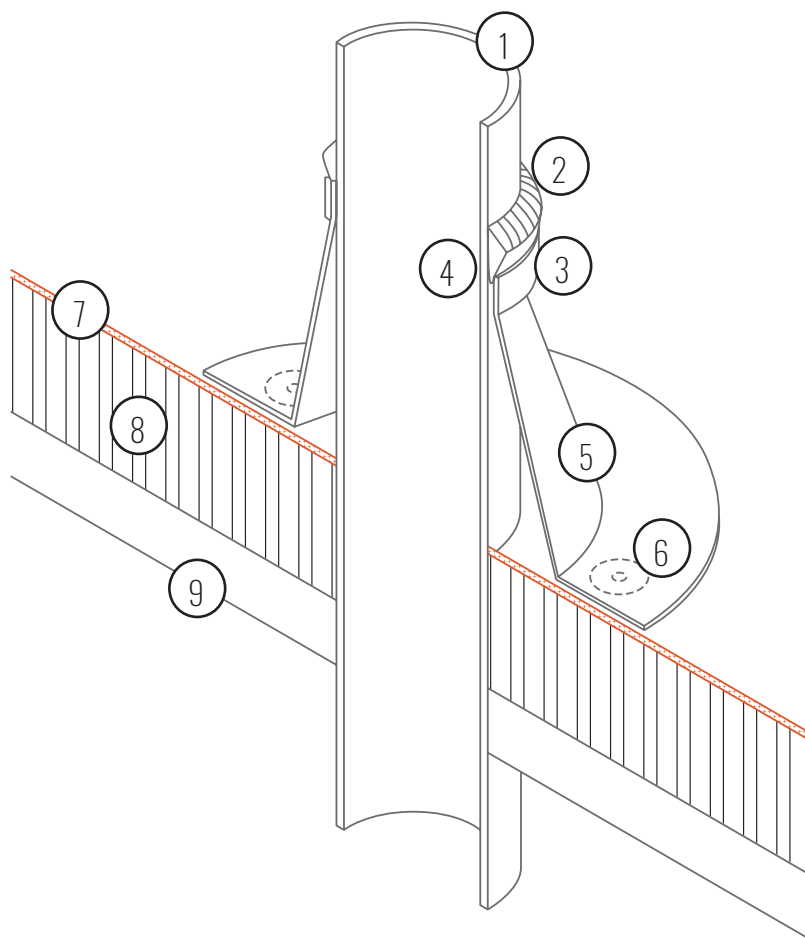

Notes:

- Please refer to the True Seal™ Specification Manual for approved insulations and cover boards
- Mechanical securement of field membrane under prefabricated flashing with True Seal™ approved fasteners and plates at a rate of 6 per pre-fabricated pipe flashing (minimum).
- Securement must be into the top flutes where applied over steel deck.
- Target patch 36" x 36" must be installed before pre-fabricated pipe flashing installation where securement fasteners and outside plate edge is less than 3" from pipe flashing field seam.
- Target patch (36" x 36") with T-patches must be installed where Prefabricated Pipe Flashing traverses through a field seam.
- Target patch must be completely welded with field seams on all sides.
- True Seal™ caulking must be present between the plumbing stack and pipe flashing as well as on top of the stainless steel pipe clamp
- Please contact the True Seal™ Technical Department for clarifications or questions at tech@true-seal.com